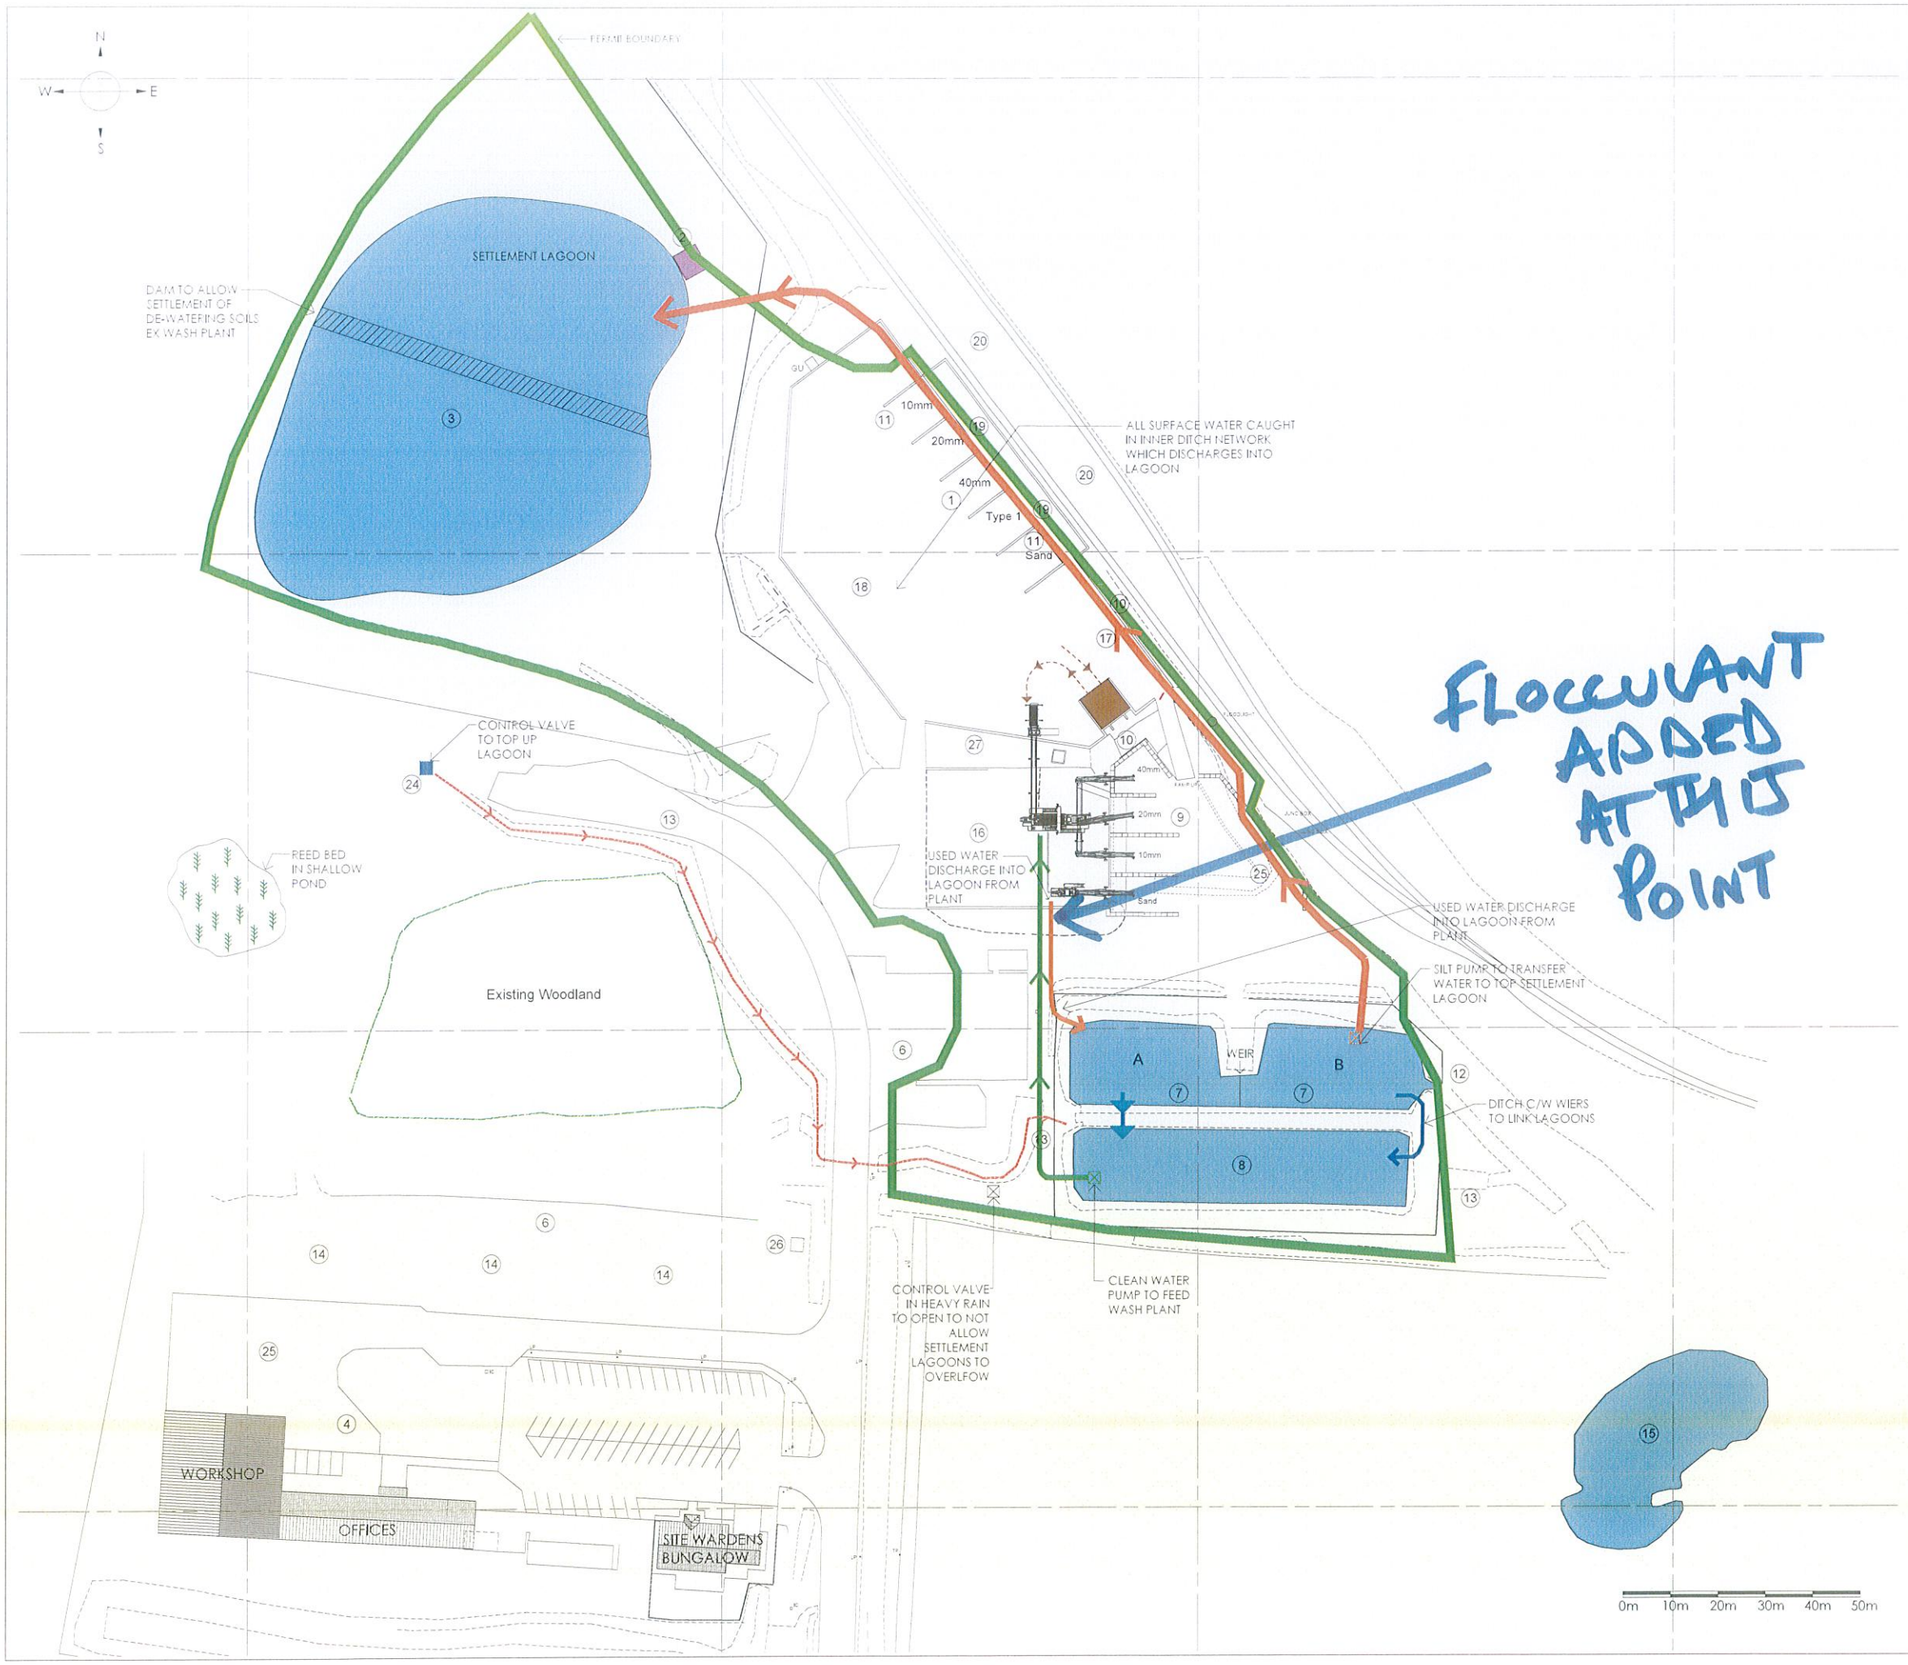


NOTES

DRAWING IS A SITE SCHEMATIC

ANY ANOMALIES ON THIS DRAWING SHOULD BE BROUGHT TO THE ATTENTION OF OLIVE COMPLIANCE

LEGEND

- PERMIT BOUNDARY
- Pumped Service from New Lagoon to Gravity Feed to Settlement Tanks
- New Surface Water Drainage
- New Surface Water Site Run-off Drainage to Settlement Tanks
- Silt Pump to control level of lagoon

1. Bays for Primary Aggregates From Primary Quarries Imported By Train via Designated Railway Siding
2. Fresh Water Pump to Gravity Feed to Wash Plant Storage Tank
3. Freshwater Storage Lagoon Settlement and Storm Water Storage Capacity not less than 13,025 cubic Metres
4. Drainage in Office/Workshop areas to be controlled and treated with Oil and Silt traps installed as required
5. Heavy Plant Access
6. Runoff from Office Area to go through Settlement Tanks
7. Existing closed settlement tanks
8. Storm Water Balancing Lagoon Capacity not less than 2,479 cubic metres
9. Bays for washed aggregates
10. Supply to wash plant storage tank
11. 5 No.5 metre High Concrete "Lego Block" Storage Bays
12. Discharge Point Controlled at 34 l/s
13. Abandoned link
14. Hardcored laydown area
15. Existing pond
16. Wash Plant
17. Bay for Material to be washed
18. Truck Traffic Flow
19. Train off loading
20. Railway Siding for Off-loading Trains
23. Truck Traffic Flow
24. Discharge Point. Flow controlled at 70l/s
25. Concrete yard and turning
26. Treatment Plant
27. Feed conveyor

SITE
NB CLARK
LONGHIRST ROAD, MORPETH, NE61 6PT

PROJECT
EA Permit Application

DRAWING TITLE
SITE DRAINAGE PLAN 2

DRAWING NUMBER	REVISION
005-2	**0**
SCALE **1:1250 @ A3**	DATE **12.11.23**

OLIVE Compliance